
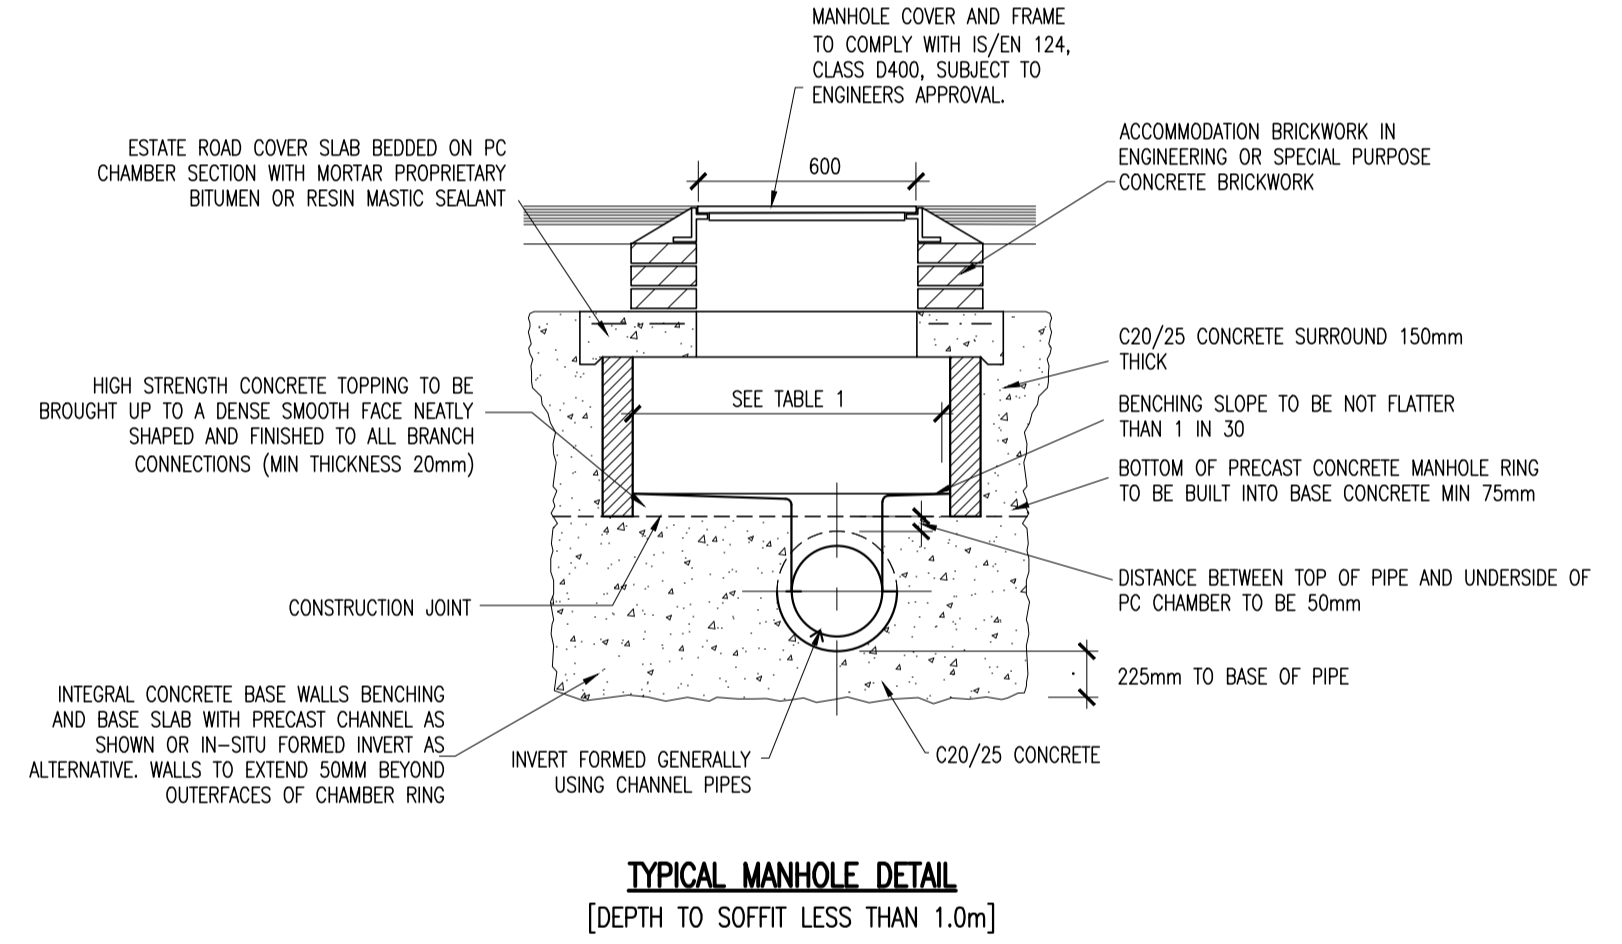
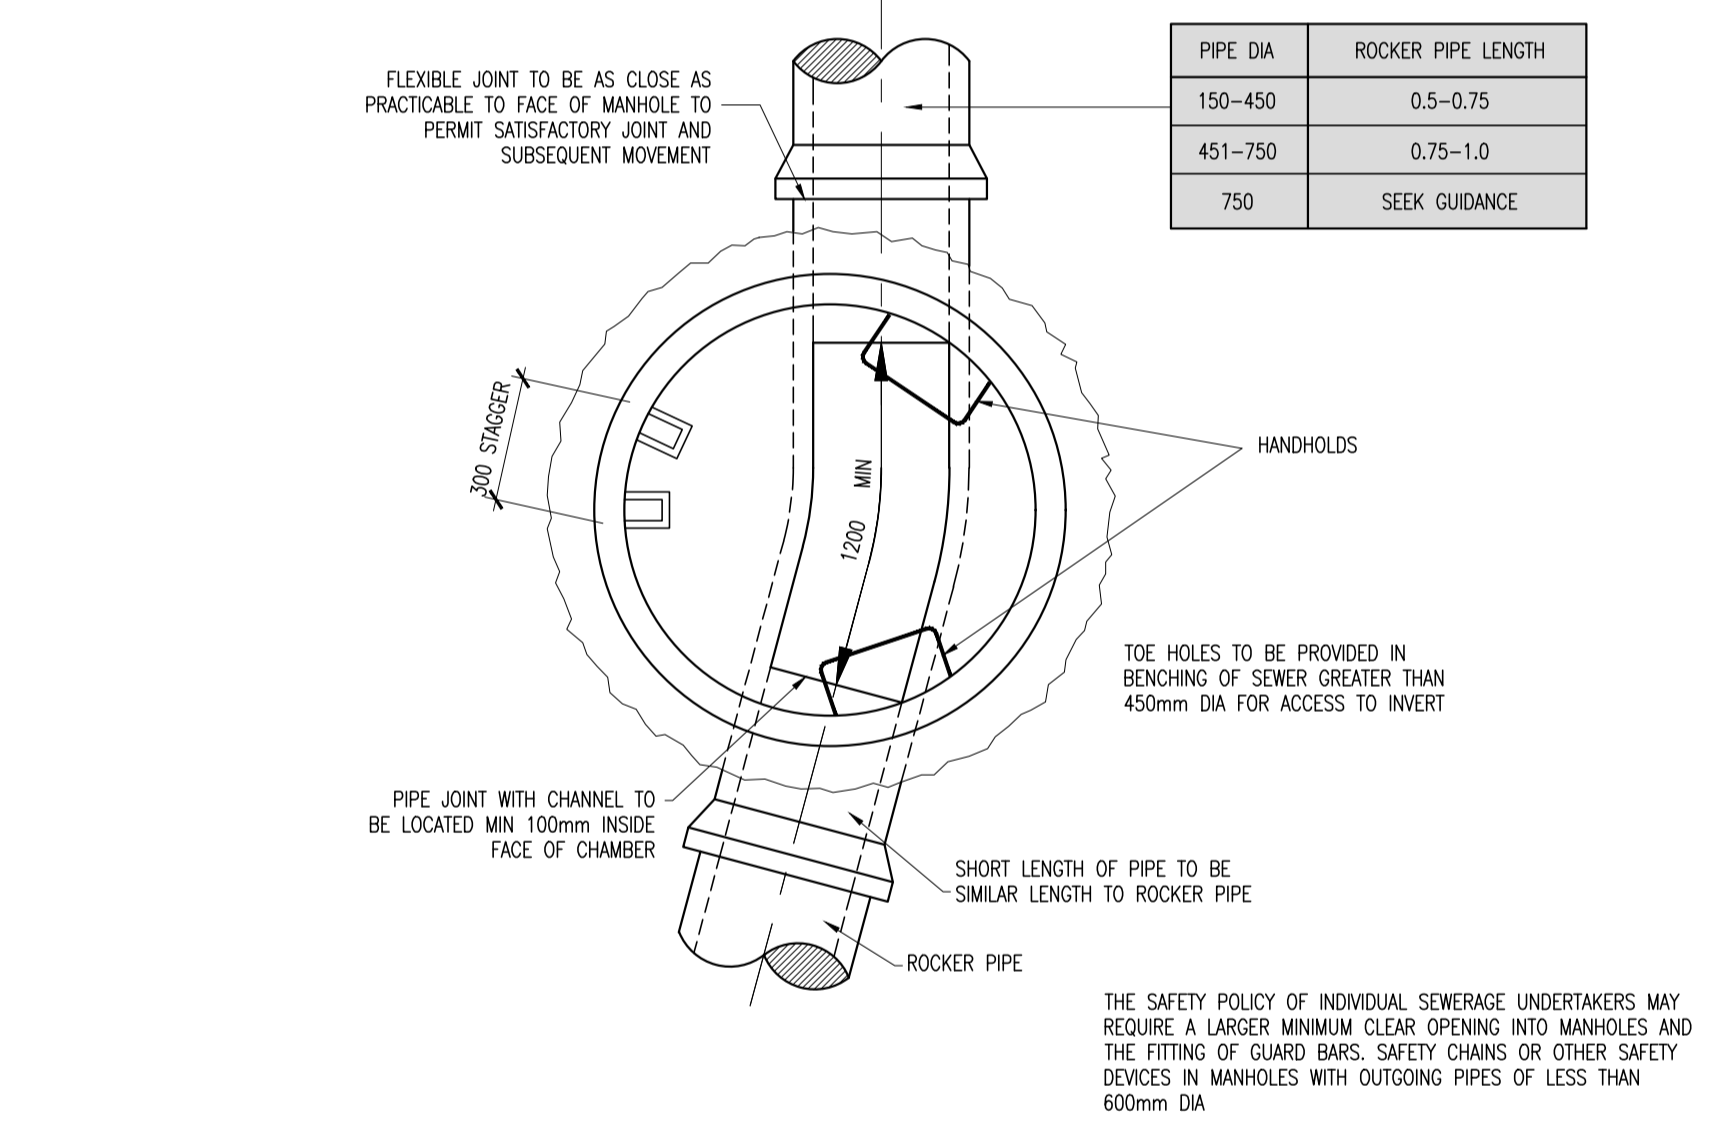
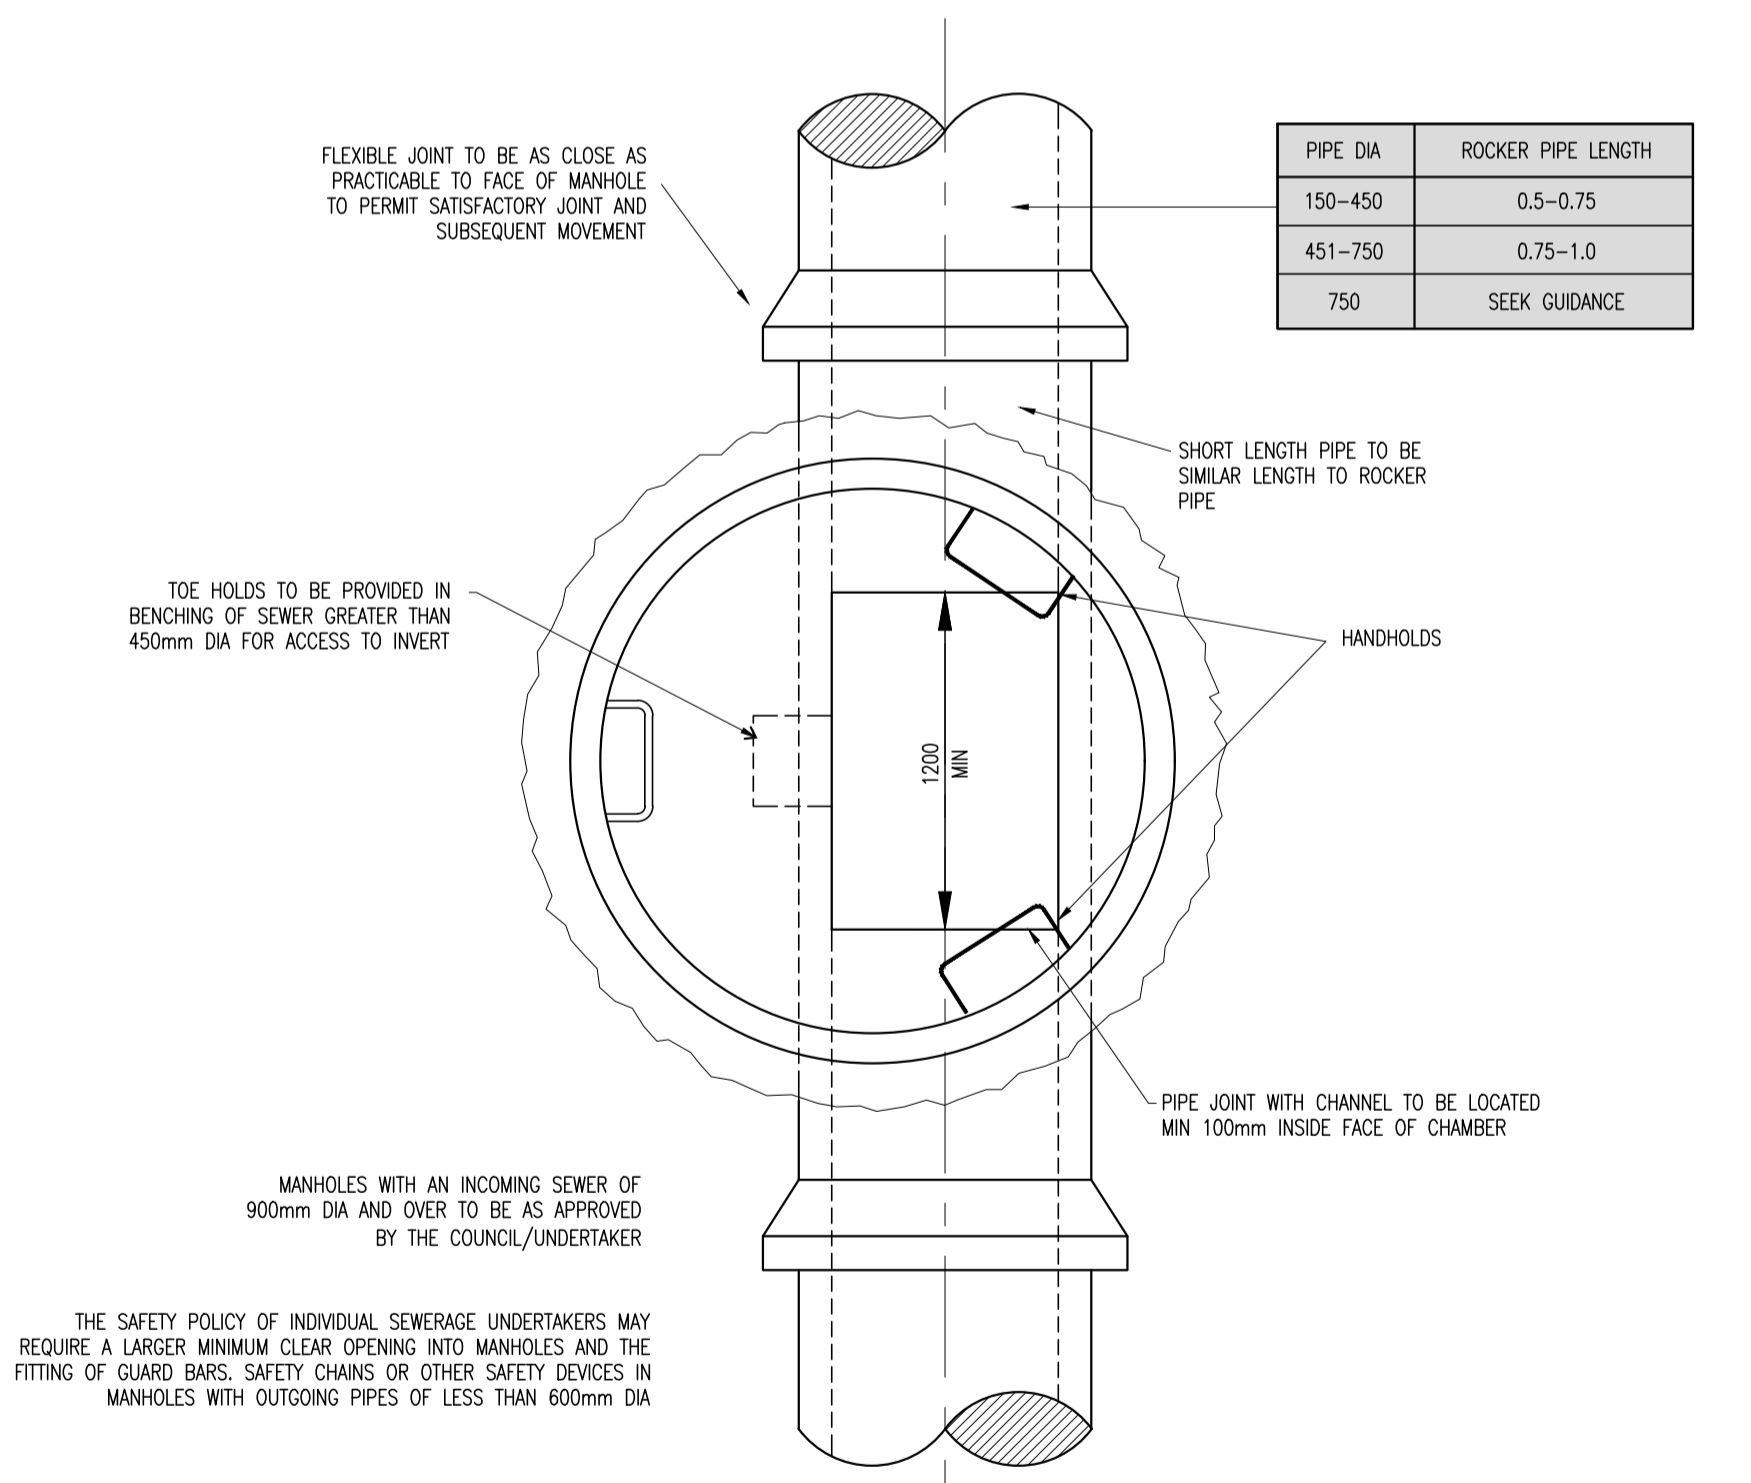
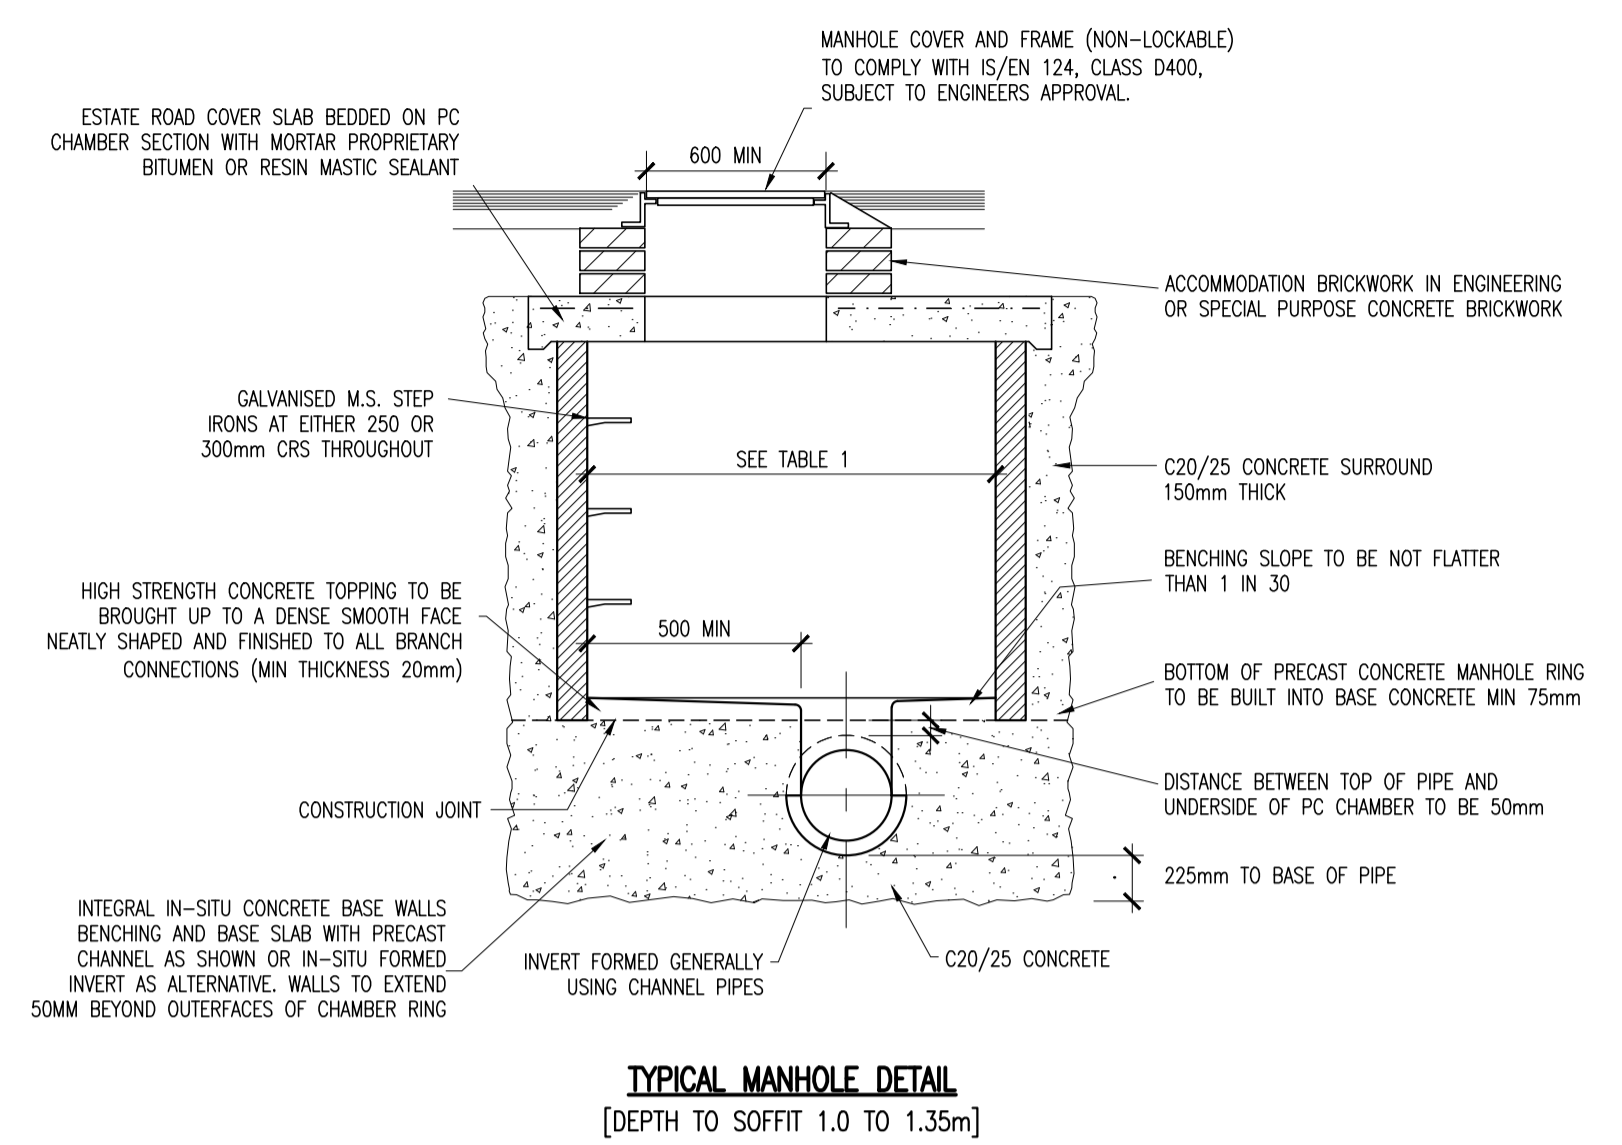
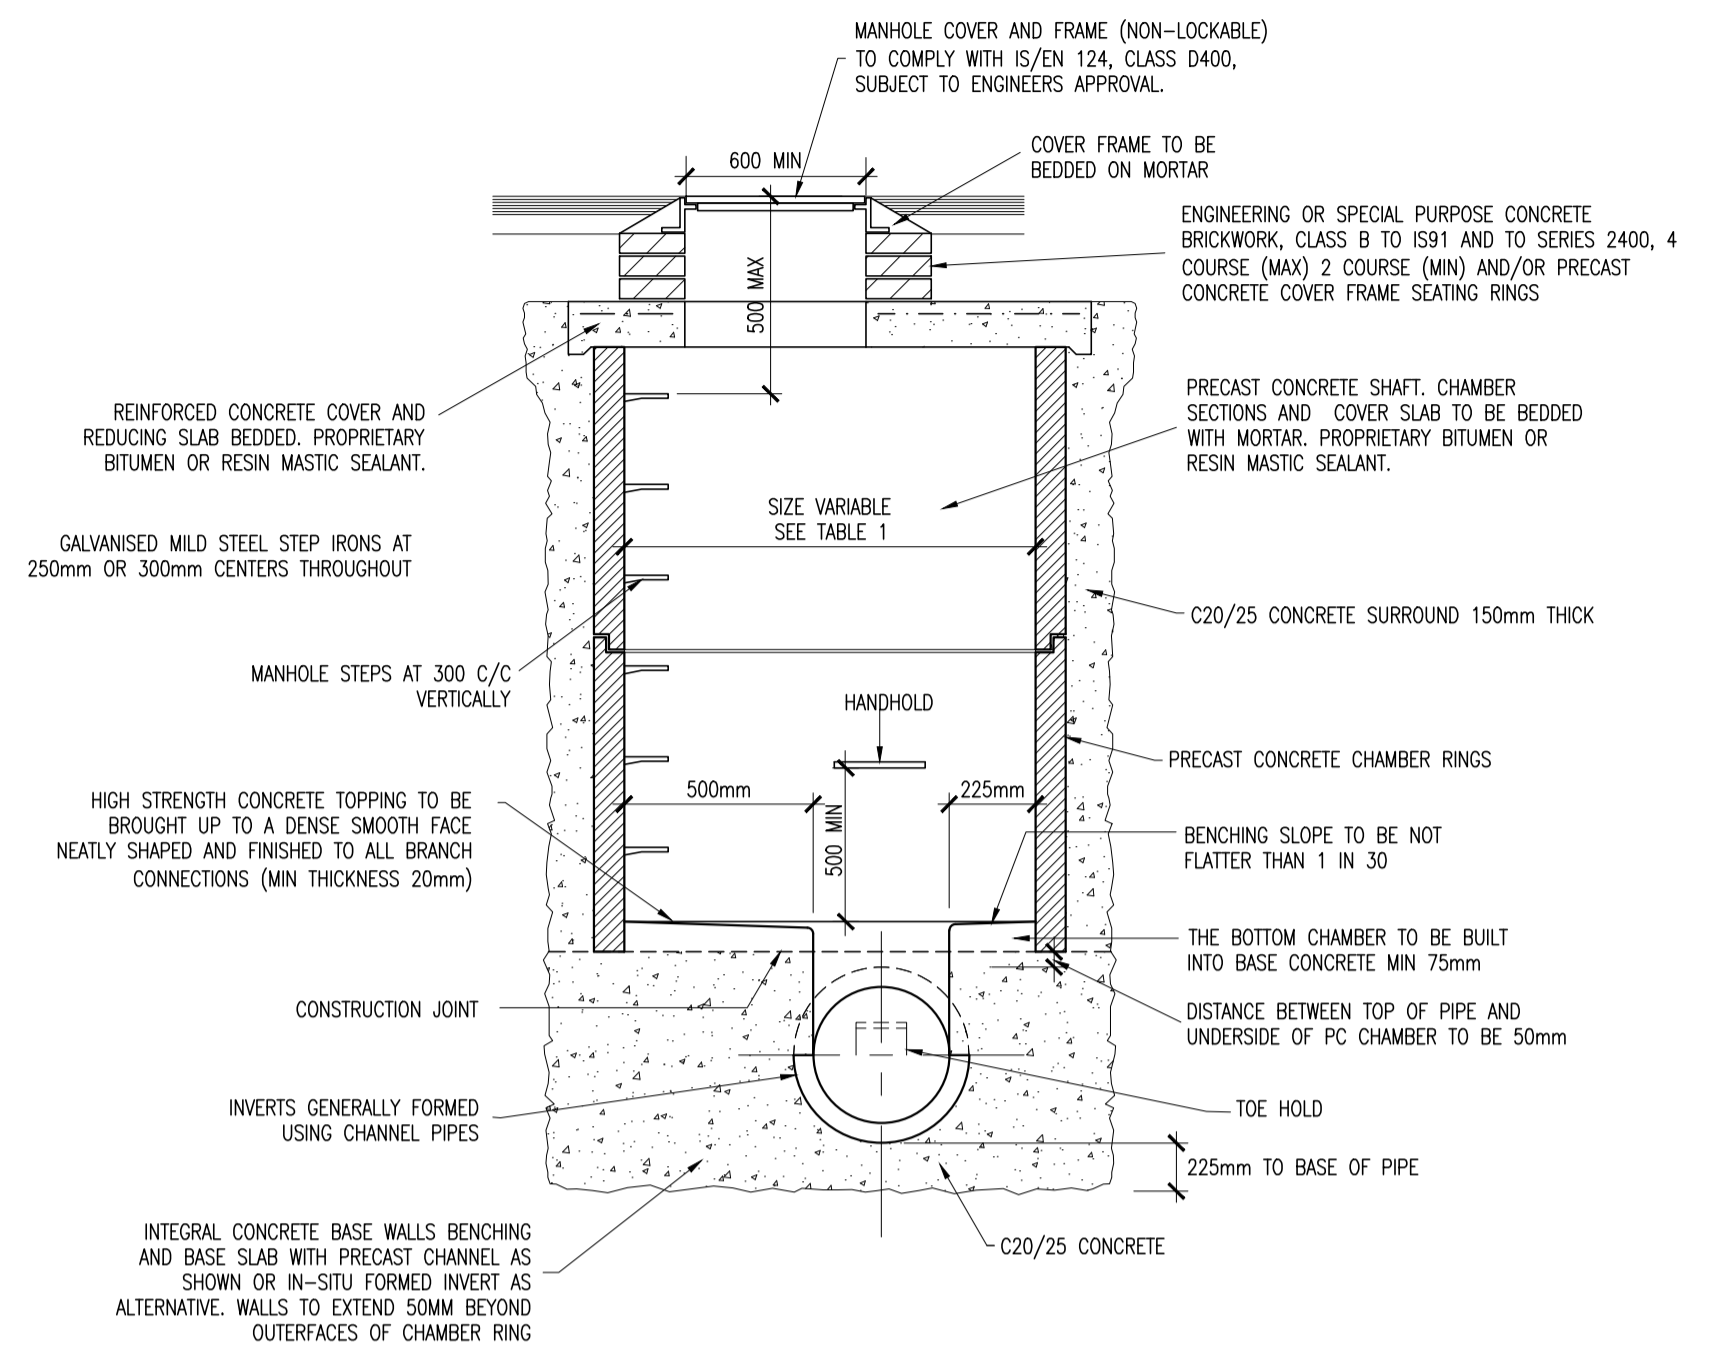


- NOTES:
1. ALL REINFORCED CONCRETE ON THIS DRAWING SHALL BE: C25/30 WITH COVER = 50mm MIN. WITH A MINIMUM CEMENT CONTENT OF 280 kg/m<sup>3</sup>, MAXIMUM W/C RATIO OF 0.65 AND SLUMP CLASS S2.
  2. SURFACE FINISHES FOR CONCRETE:
    - CLASS F1 FOR ALL CONCRETE 100mm OR MORE BELOW GROUND LEVEL.
    - CLASS F3 FOR ALL EXPOSED CONCRETE ABOVE 100mm BELOW GROUND LEVEL.
  3. ALL EXPOSED CORNERS ON CONCRETE SHALL BE CHAMFERED WITH 25mm x 25mm CHAMFERS.
  4. ALL STRUCTURAL CONCRETE (HEADWALLS, RC MANHOLES, PETROL INTERCEPTOR SLABS) TO RECEIVE MC DUR 1680 (OR SIMILAR APPROVED TAR MODIFIED EPOXY RESIN) TO ALL BURIED SURFACES, TO FINISH 100mm BELOW GROUND LEVEL.
  5. ALL SEWERS SHALL BE PRESSURE TESTED PRIOR TO BACKFILLING.
  6. RIGID PIPES SHALL MEAN CAST OR SPUN IRON, CONCRETE, ASBESTOS CEMENT OR CLAY.

**NOTE:**  
ALL WORKS TO BE UNDERTAKEN IN ACCORDANCE WITH:  
 • T11 SPECIFICATION FOR ROADWORKS  
 • GREATER DUBLIN CODE OF PRACTICE FOR DRAINAGE WORKS  
 • RECOMMENDATIONS FOR SITE DEVELOPMENT WORKS

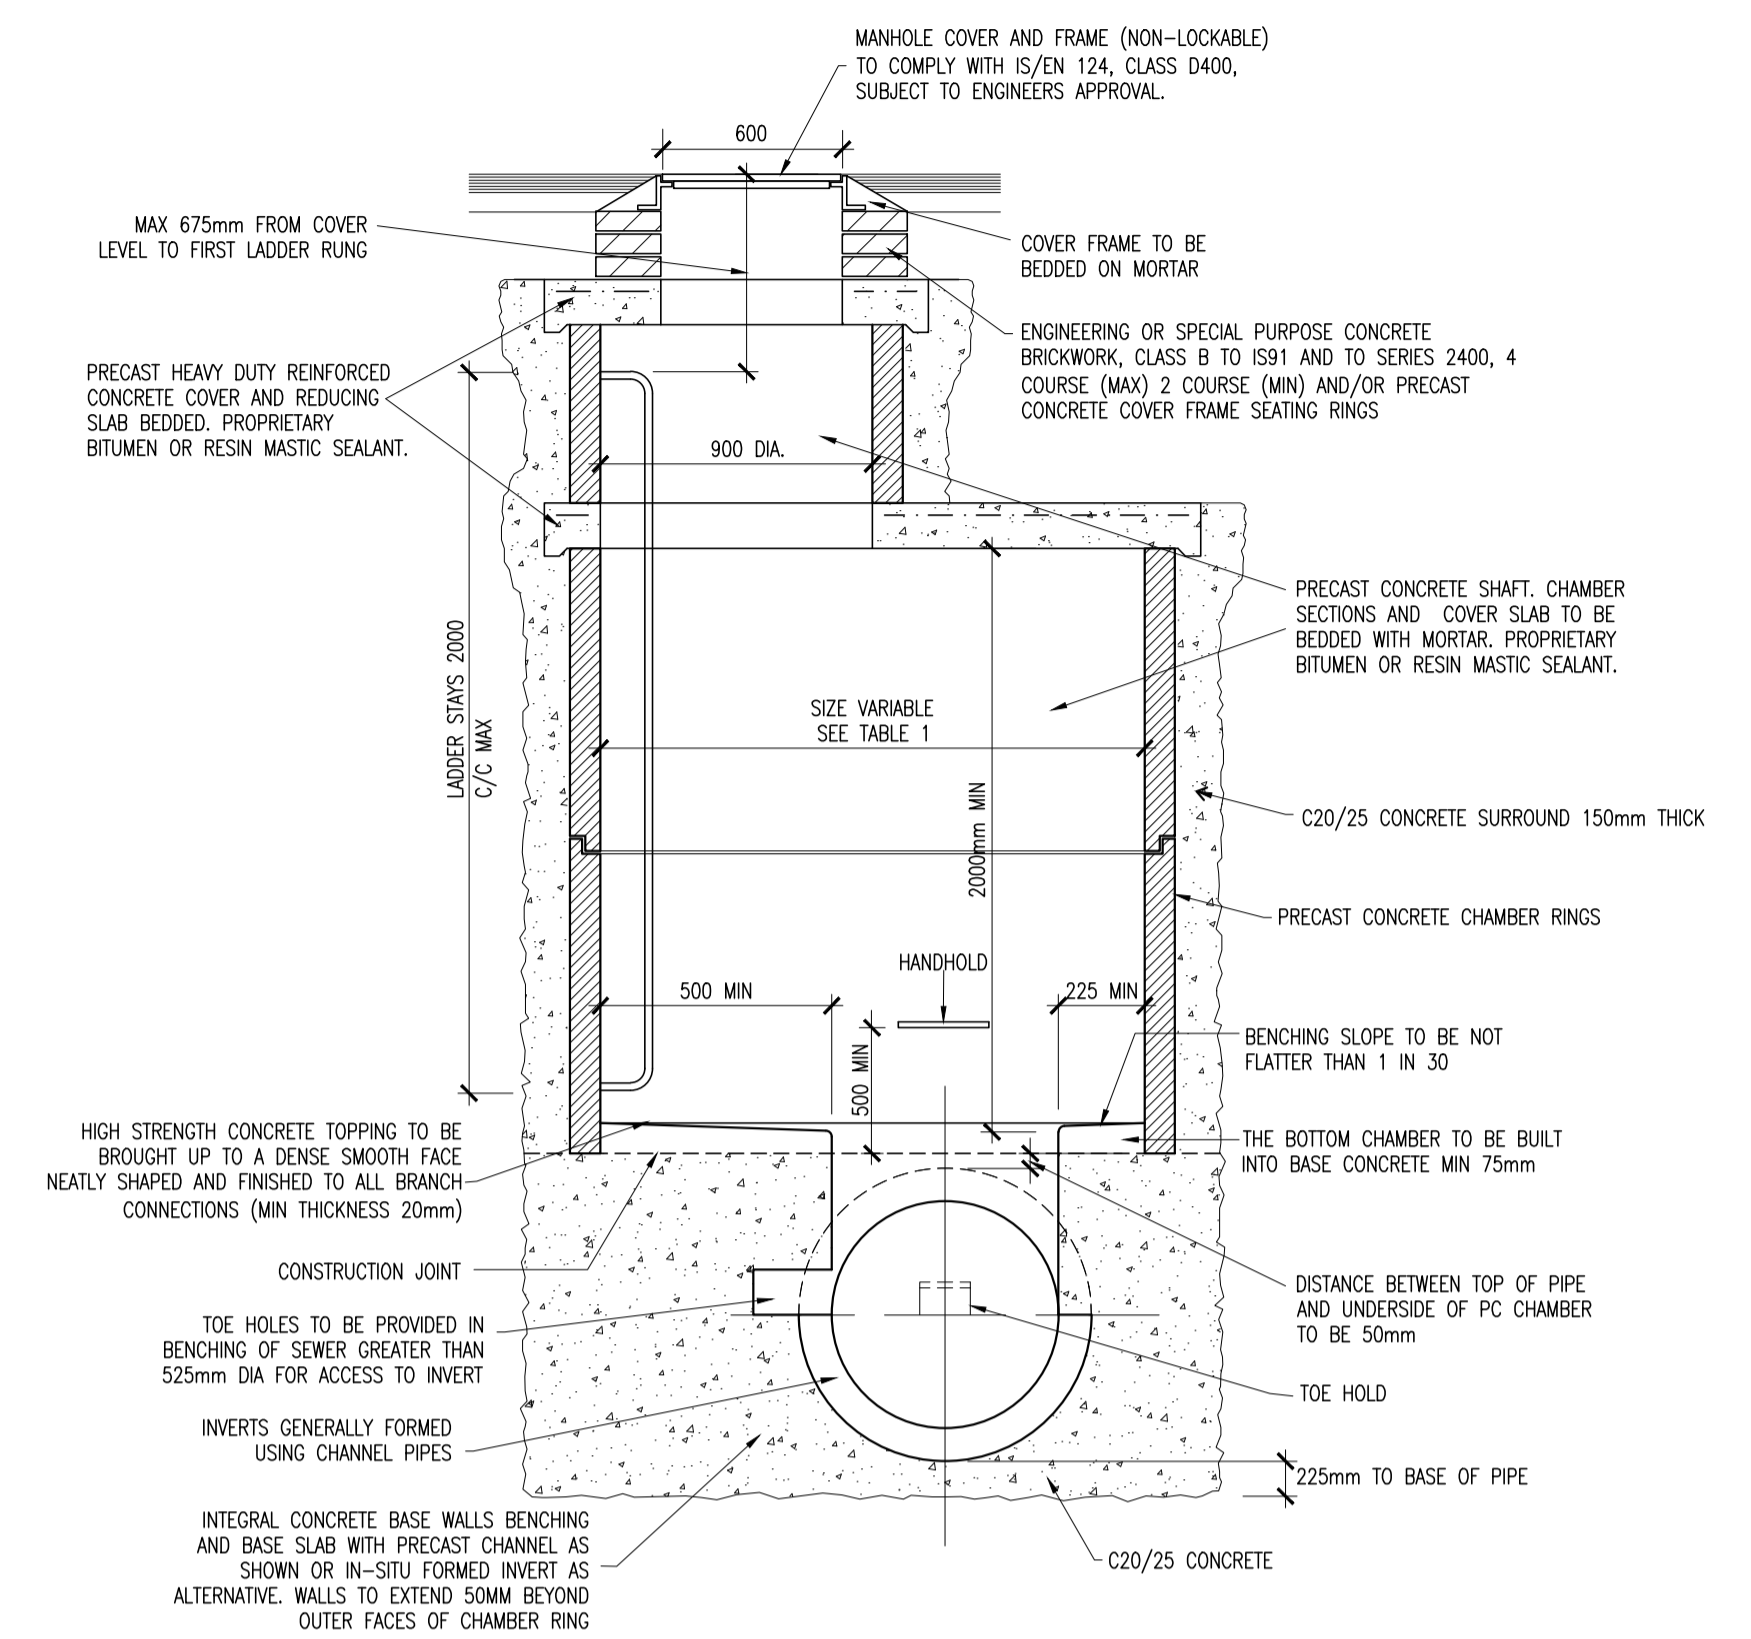

DIAMETER OF LARGEST PIPE IN MANHOLE (mm)	CHAMBER SECTION DIAMETER (mm)		
	1m - 3m	3m - 6m	6m - 12m
LESS THAN 375	1050	1050	1500
<600	1200	1200	1500
<675	1350	1350	1500
<750	1350	1500	1500
<900	1500	1500	1500
<1200	2100	2100	2100

TABLE 1

